


ALL MATERIAL TO BE 316 STAINLESS STEEL

- ① 3" SCHEDULE 40 PVC SOCKET FEMALE ADAPTER
- ② 3"x4" NIPPLE
- ③ FLANGES WITH HEX HEAD CAP SCREW 5/8" x 3-1/2"
18-8 SS WITH 18-8 WASHER AND 18-8 5/8"-11
NYLOCK NUT
- ④ 3" THREADED PIPE CUT TO LENGTH
- ⑤ 3"x3"x3" TEE
- ⑥ 1/8" RUBBER GASKET
- ⑦ ROMAC MODEL #511 EPOXY COATED WITH SS HARDWARE
- ⑧ 3" FULL PORT BALL VALVE
- ⑨ 3" MALE CAMLOCK
- ⑩ 3" DUST CAP
- ⑪ 2"x3" REDUCER
- ⑫ 2"x4" NIPPLE
- ⑬ 2" FULL PORT BALL VALVE
- ⑭ 2" MALE CAMLOCK
- ⑮ 2" FEMALE CAMLOCK WITH HITCH PINS
INSTALLED IN LOCK POSITION
- ⑯ 1" FULL PORT BALL VALVE
- ⑰ 1" PIPE CAP
- ⑱ VENT-TECH OR VENT-O-MAT AIR RELEASE VALVE
- ⑲ LINK SEAL

M.C.

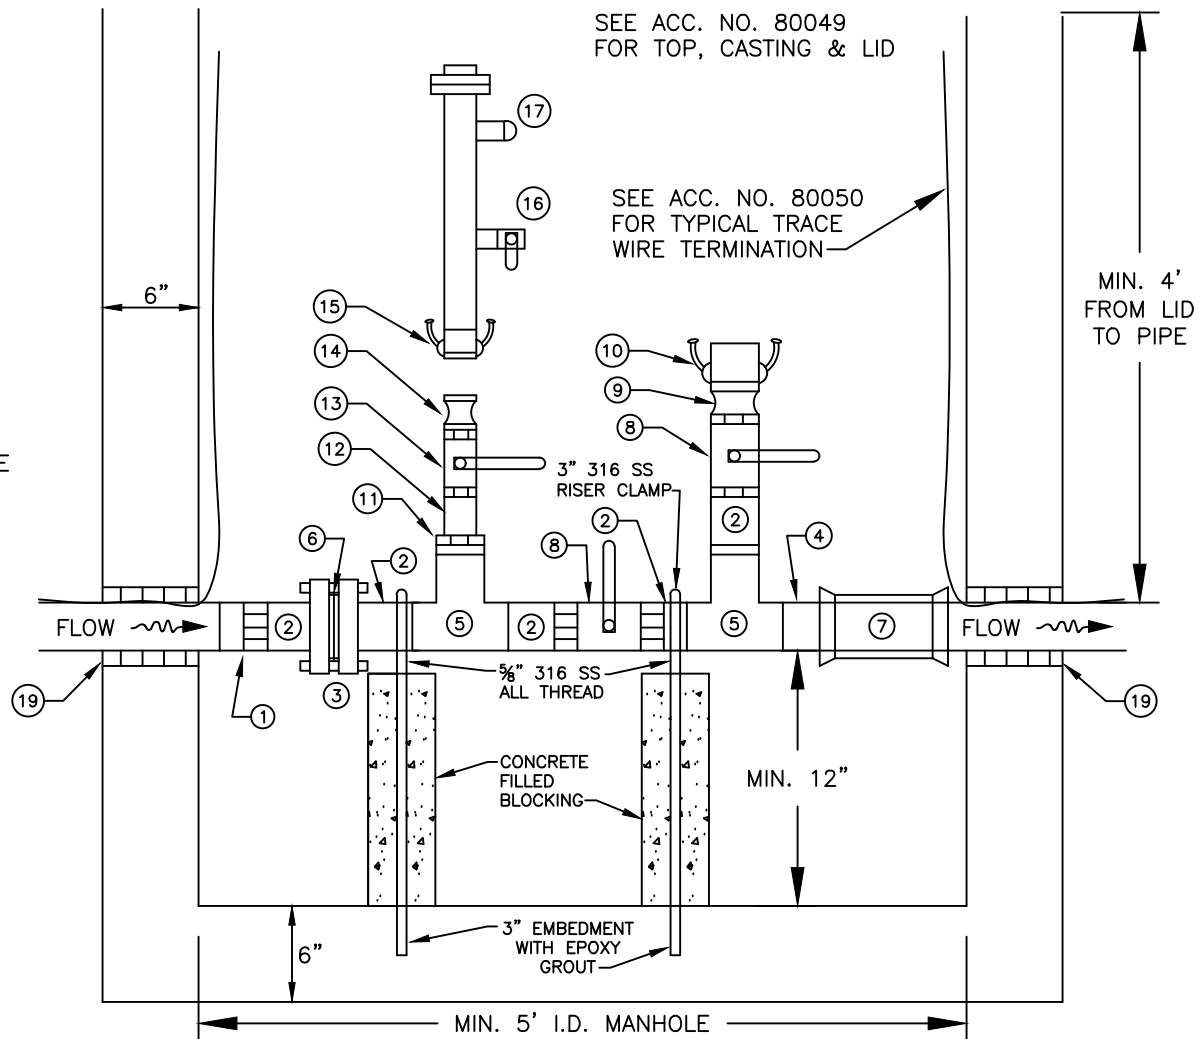

APPROVED:

SEWERS CHIEF ENGINEER

ACC. NO. 80046