


MATERIAL LIST – ALL MATERIAL TO BE 316 STAINLESS STEEL

- ① 3"Øx4" NIPPLE
- ② 3" THREADED PIPE CUT TO LENGTH
- ③ 3"x3"x3" TEE
- ④ 3" FLANGE ADAPTER
- ⑤ 3" FULL PORT BALL VALVE
- ⑥ 3" MALE CAMLOCK
- ⑦ 3" DUST CAP
- ⑧ LINK SEAL

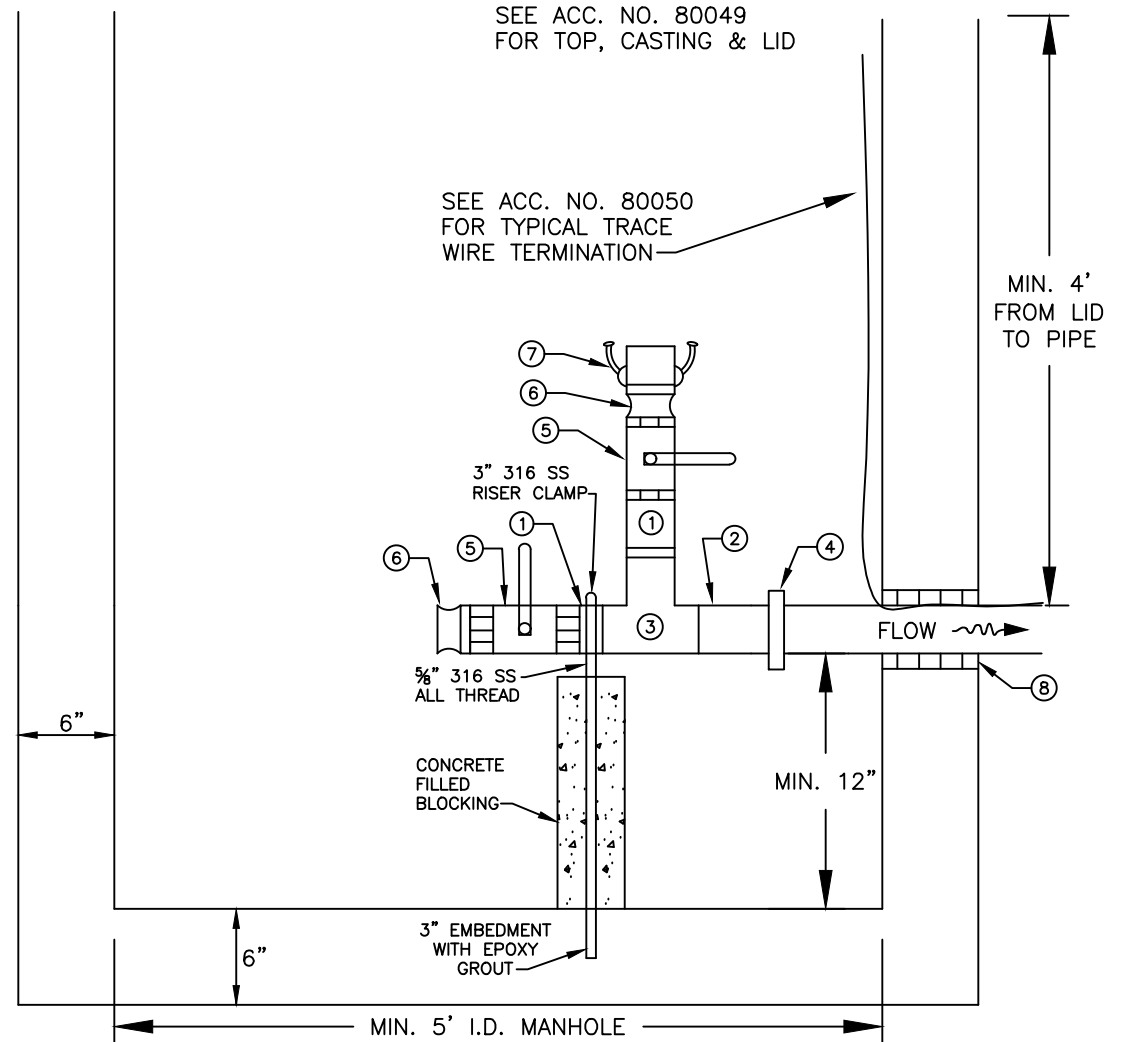

FOR 2 INCH LPFM, USE SAME COMPONENTS BUT
SWAP OUT 3" PARTS FOR 2" PARTS, AS APPLICABLE.

THE METROPOLITAN SEWER DISTRICT
OF GREATER CINCINNATI
**LOW PRESSURE SEWER SYSTEM
STANDARD TERMINAL
FLUSHING MANHOLE**

NO SCALE

DATE: AUGUST 2026

APPROVED:

SEWERS CHIEF ENGINEER

M.C.

ACC. NO. 80047