


MATERIAL LIST
ALL MATERIAL TO BE 316
STAINLESS STEEL

- ① LINK SEAL
- ② ROMAC COUPLING
- ③ STAINLESS STEEL PIPE
BETWEEN ROMAC COUPLINGS (TYP.)
- ④ TEE FITTING
- ⑤ FULL PORT BALL VALVE

NOTES:
 BALL VALVES ARE VERTICAL TO
 LPFM BUT ARE SHOWN
 HORIZONTAL FOR CLARITY.

SEE ACC. NO. 80049
 FOR TOP, CASTING & LID

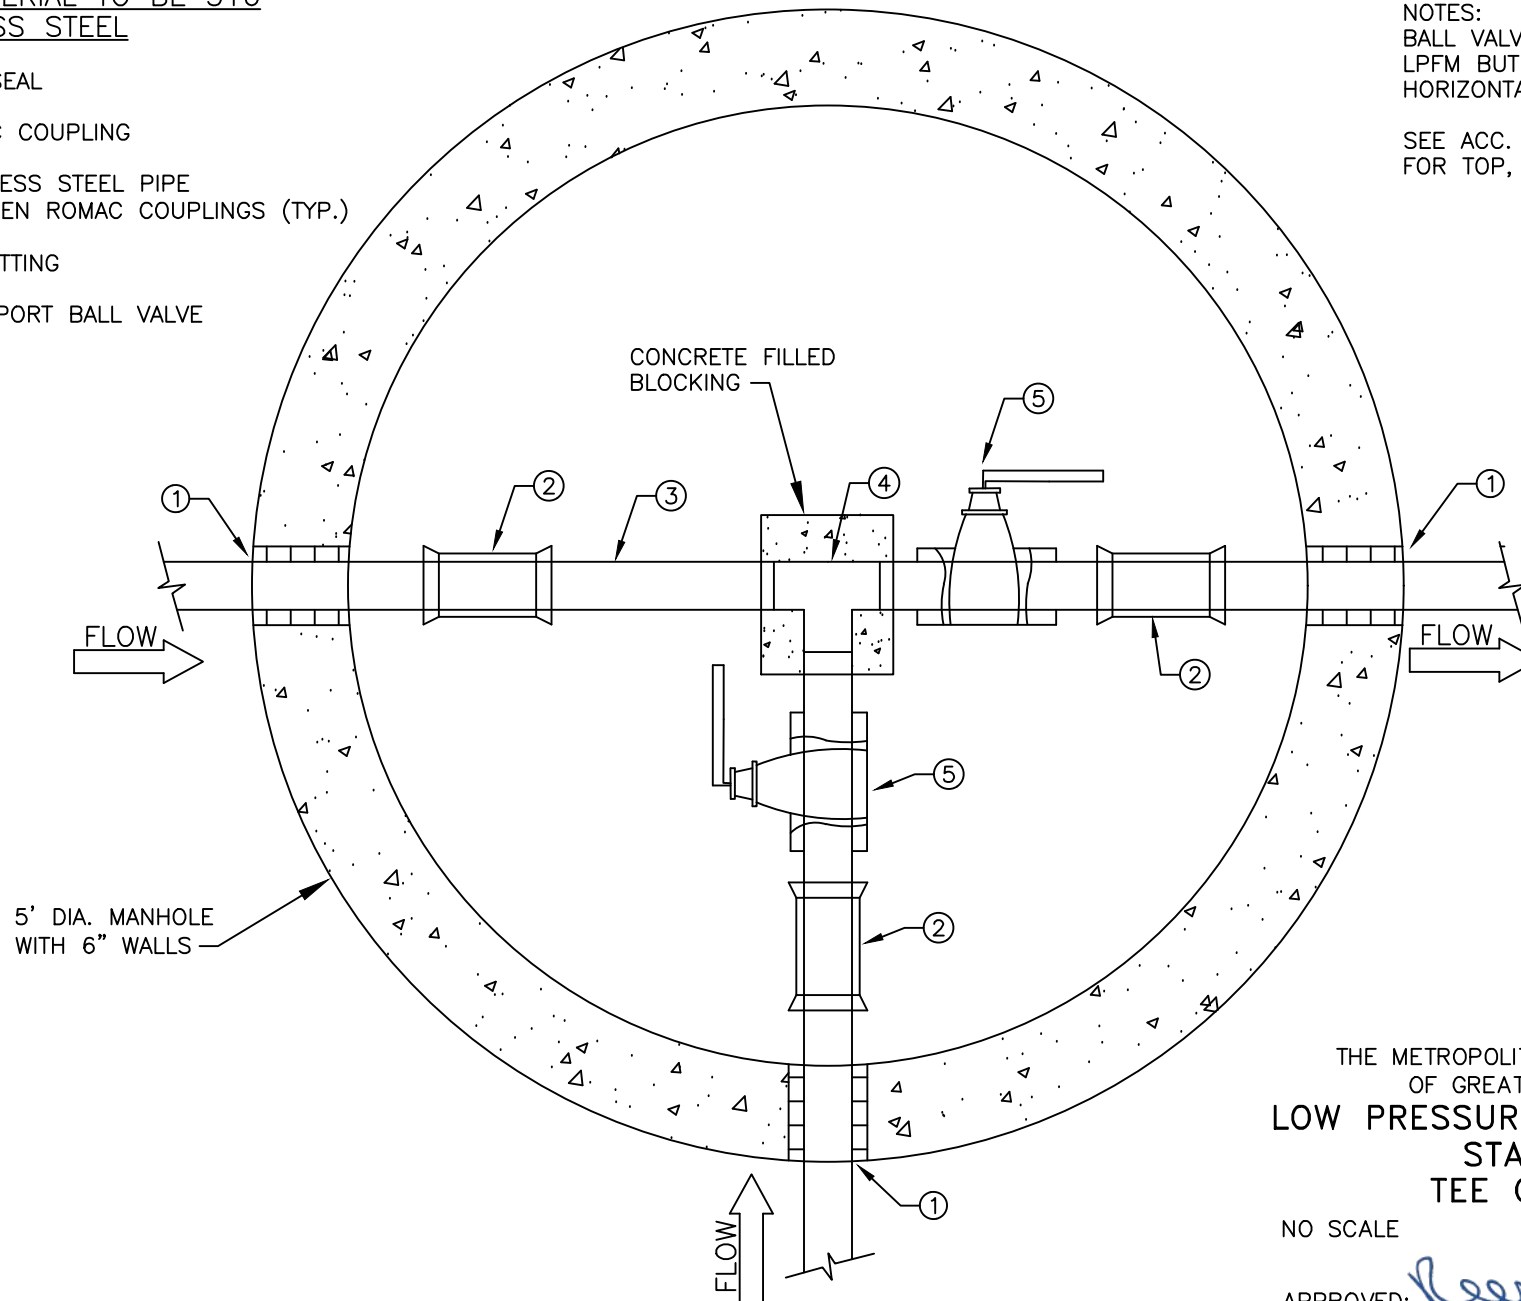

THE METROPOLITAN SEWER DISTRICT
 OF GREATER CINCINNATI
LOW PRESSURE SEWER SYSTEM
STANDARD
TEE CHAMBER

NO SCALE

DATE: AUGUST 2026

APPROVED:

Reese P. Johnson
 SEWERS CHIEF ENGINEER

M.C.

ACC. NO. 80048