
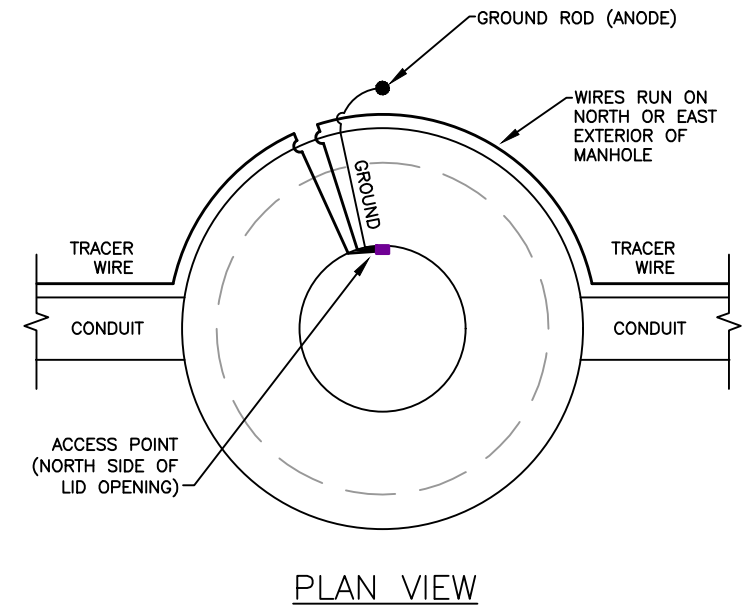


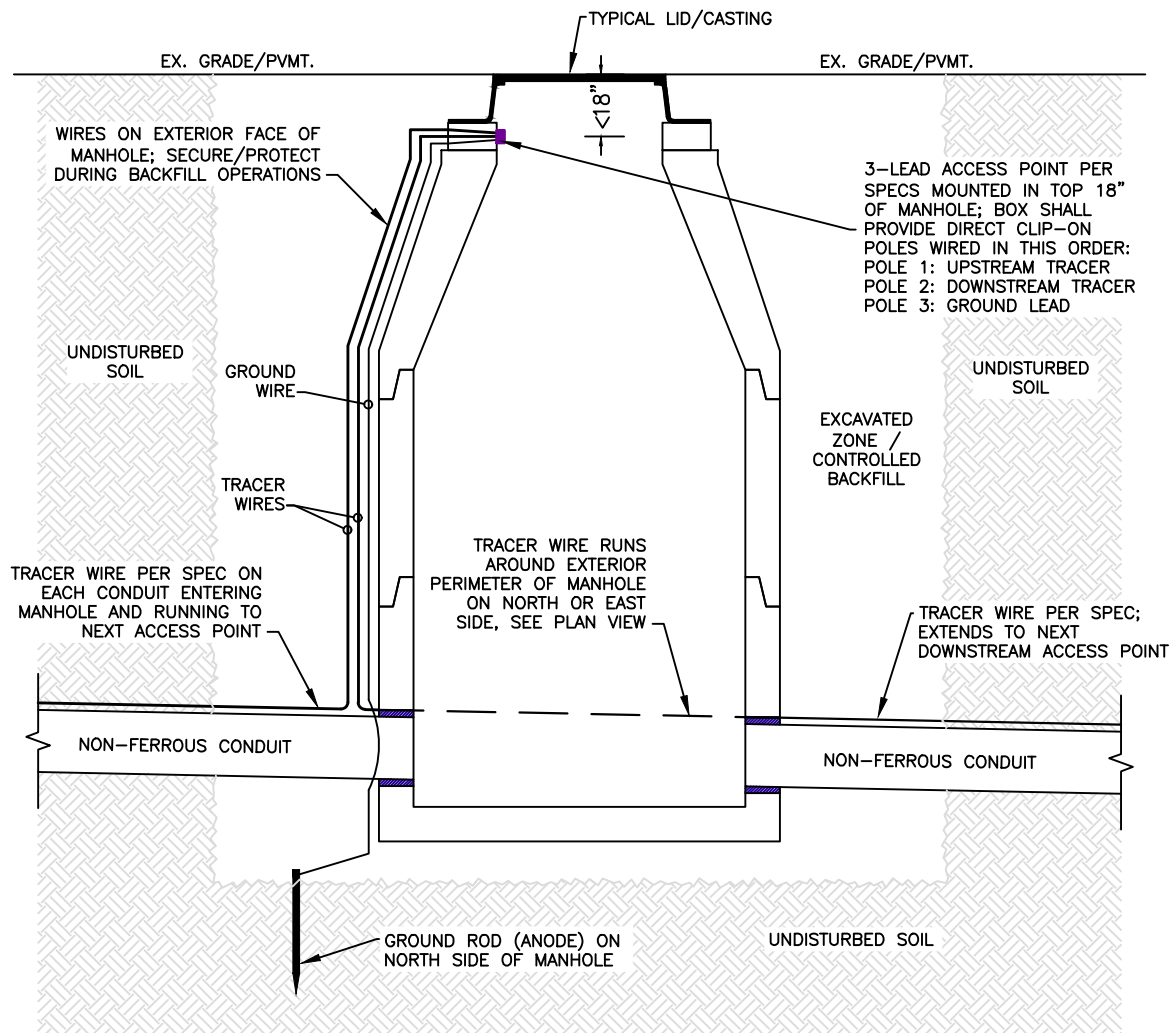

TRACER WIRE SPECIFICATIONS

1. TRACER SHALL BE TRACE-SAFE RT SERIES, PART #RT1803W, APWA COLOR-CODED GREEN, OR APPROVED EQUAL.
2. ALL TRACER WIRES ENTERING MANHOLE SHALL FEATURE FIVE (5) FEET OF COILED TRACER WIRE SUPPORTED ON A NON-CORROSIVE HOOK LOCATED NO MORE THAN 24" BELOW GRADE.
3. TRACER WIRE MUST REMAIN CONTINUOUS WITHOUT SPLICES BETWEEN ACCESS POINTS (MANHOLES).

THE METROPOLITAN SEWER DISTRICT OF GREATER CINCINNATI LOW PRESSURE SEWER SYSTEM STANDARD TRACER WIRE TERMINATION AT MANHOLE

NO SCALE

DATE: AUGUST 2026

APPROVED:

Reese P. Johnson
SEWERS CHIEF ENGINEER

M.C.

ACC. NO. 80050