


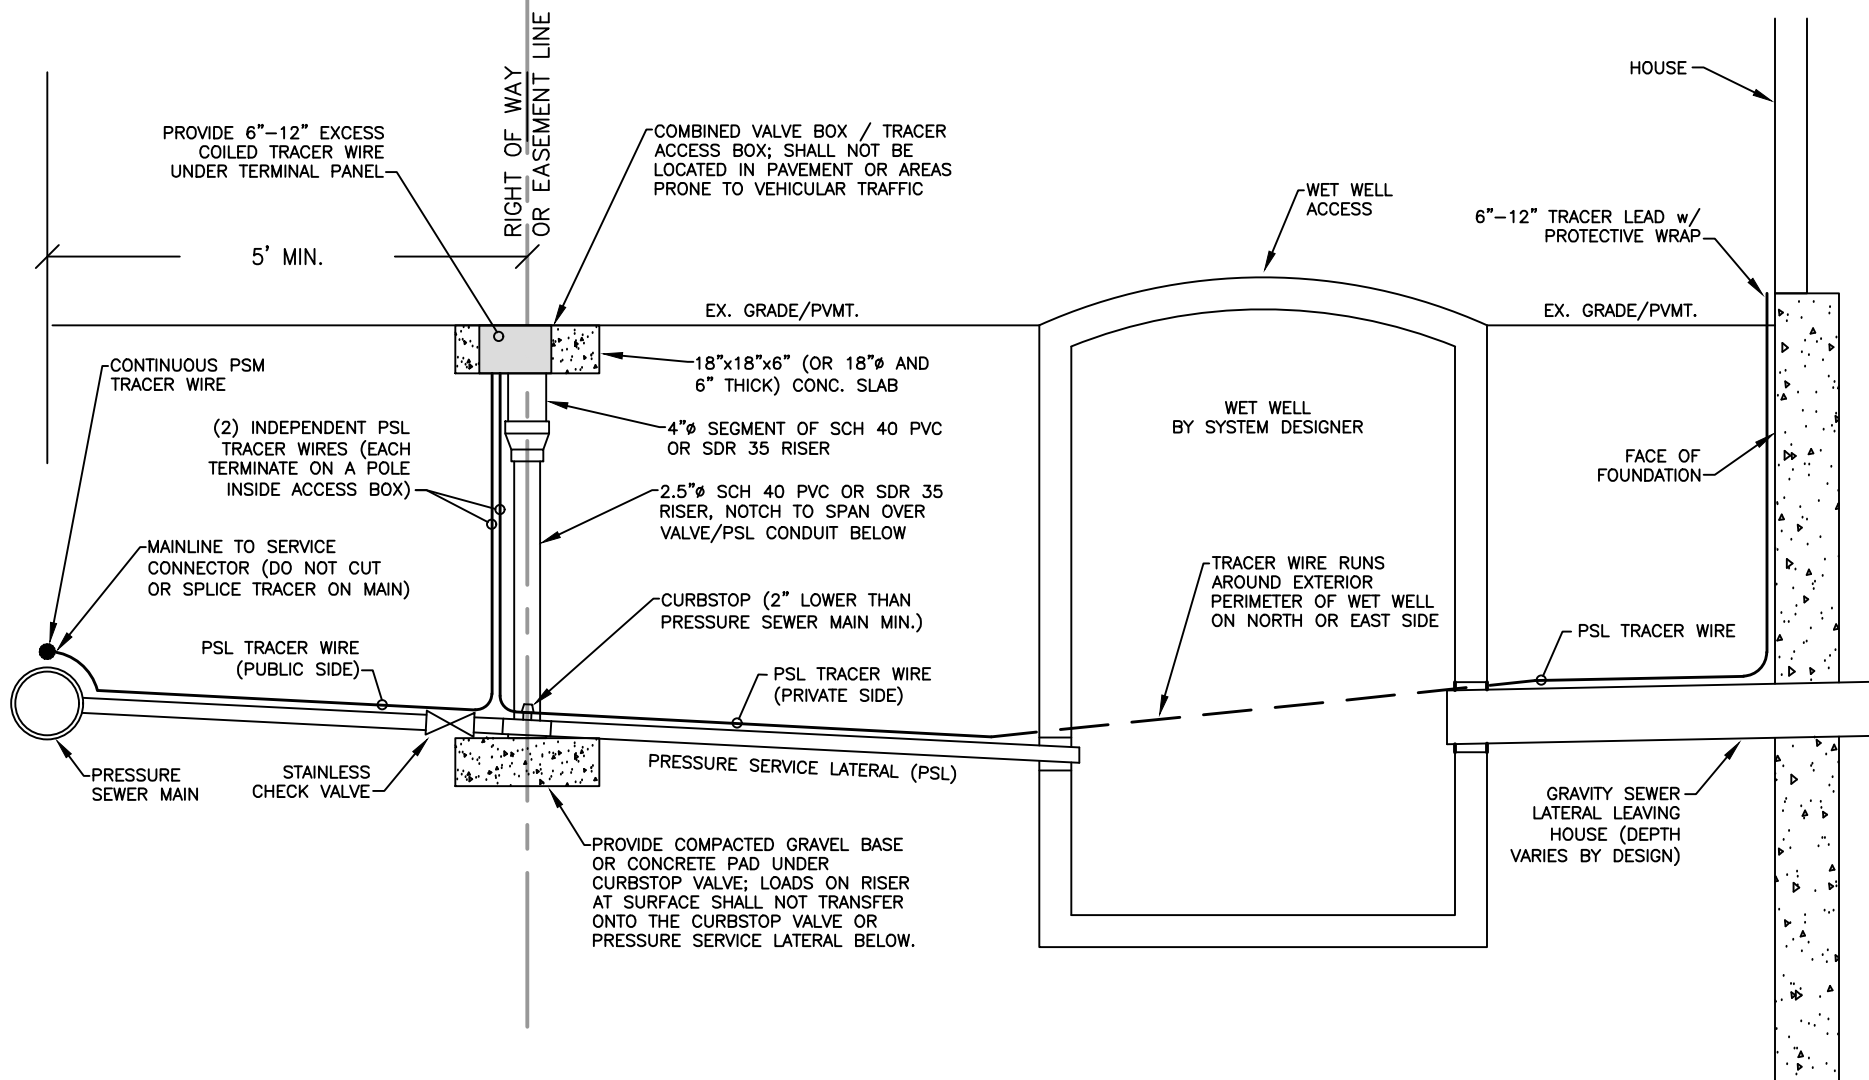

NOTES:

1. ALL PRESSURE SERVICE LATERALS (PSLs) SHALL HAVE A MINIMUM GROUND COVER OF 4 FEET.
2. EACH PSL SHALL HAVE TWO (2) CHECK VALVES; ONE AT THE PUMP, AND ANOTHER AT THE RIGHT OF WAY AND/OR DEDICATED EASEMENT LINE.
3. PSL CONNECTION TO THE PRESSURE SEWER MAIN SHALL ONLY UTILIZE A MANUFACTURED FITTING, NO SADDLES OR HOT TAPS WILL BE PERMITTED.

THE METROPOLITAN SEWER DISTRICT
OF GREATER CINCINNATI
**LOW PRESSURE SEWER SYSTEM
STANDARD PRESSURE SERVICE
LATERAL TRACE WIRE**

NO SCALE

DATE: AUGUST 2026

APPROVED:

Reese P. Johnson
SEWERS CHIEF ENGINEER

M.C.

ACC. NO. 80051